

© Copyright SEK. Reproduction in any form without permission is prohibited.

Datahallsutrymmen och tillhörande system – Del 4-2: Energieffektivitet

*Information technology –
Data centre facilities and infrastructures –
Part 4-2: Power Usage Effectiveness*

Som svensk standard gäller europastandarden EN 50600-4-2:2016. Den svenska standarden innehåller den officiella engelska språkversionen av EN 50600-4-2:2016.

ICS 35.020.00; 35.110.00; 35.160.00

Denna standard är fastställd av SEK Svensk Elstandard,
som också kan lämna upplysningar om **sakinnehållet** i standarden.
Postadress: Box 1284, 164 29 KISTA
Telefon: 08 - 444 14 00.
E-post: sek@elstandard.se. Internet: www.elstandard.se

Standarder underlättar utvecklingen och höjer elsäkerheten

Det finns många fördelar med att ha gemensamma tekniska regler för bl a mätning, säkerhet och provning och för utförande, skötsel och dokumentation av elprodukter och elanläggningar.

Genom att utforma sådana standarder blir säkerhetsfordringar tydliga och utvecklingskostnaderna rimliga samtidigt som marknadens acceptans för produkten eller tjänsten ökar.

Många standarder inom elområdet beskriver tekniska lösningar och metoder som åstadkommer den elsäkerhet som föreskrivs av svenska myndigheter och av EU.

SEK är Sveriges röst i standardiseringsarbetet inom elområdet

SEK Svensk Elstandard svarar för standardiseringen inom elområdet i Sverige och samordnar svensk medverkan i internationell och europeisk standardisering. SEK är en ideell organisation med frivilligt deltagande från svenska myndigheter, företag och organisationer som vill medverka till och påverka utformningen av tekniska regler inom elektrotekniken.

SEK samordnar svenska intressenters medverkan i SEKs tekniska kommittéer och stödjer svenska experters medverkan i internationella och europeiska projekt.

Stora delar av arbetet sker internationellt

Utformningen av standarder sker i allt väsentligt i internationellt och europeiskt samarbete. SEK är svensk nationalkommitté av International Electrotechnical Commission (IEC) och Comité Européen de Normalisation Electrotechnique (CENELEC).

Standardiseringsarbetet inom SEK är organiserat i referensgrupper bestående av ett antal tekniska kommittéer som speglar hur arbetet inom IEC och CENELEC är organiserat.

Arbetet i de tekniska kommittéerna är öppet för alla svenska organisationer, företag, institutioner, myndigheter och statliga verk. Den årliga avgiften för deltagandet och intäkter från försäljning finansierar SEKs standardiseringsverksamhet och medlemsavgift till IEC och CENELEC.

Var med och påverka!

Den som deltar i SEKs tekniska kommittéarbete har möjlighet att påverka framtida standarder och får tidig tillgång till information och dokumentation om utvecklingen inom sitt teknikområde. Arbetet och kontakterna med kollegor, kunder och konkurrenter kan gynnsamt påverka enskilda företags affärsutveckling och bidrar till deltagarnas egen kompetensutveckling.

Du som vill dra nytta av dessa möjligheter är välkommen att kontakta SEKs kansli för mer information.

SEK Svensk Elstandard

Box 1284
164 29 Kista
Tel 08-444 14 00
www.elstandard.se

EUROPEAN STANDARD
NORME EUROPÉENNE
EUROPÄISCHE NORM

EN 50600-4-2

December 2016

ICS 35.020; 35.110; 35.160

English Version

**Information technology - Data centre facilities and infrastructures
- Part 4-2: Power Usage Effectiveness**

Technologie de l'information - Installation et infrastructures
de centres de traitement de données - Partie 4-2 : Efficacité
de l'utilisation de l'énergie

Informationstechnik - Einrichtungen und Infrastrukturen von
Rechenzentren - Teil 4-2: Kennzahl zur eingesetzten
Energie

This European Standard was approved by CENELEC on 2016-10-10. CENELEC members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration.

Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the CEN-CENELEC Management Centre or to any CENELEC member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CENELEC member into its own language and notified to the CEN-CENELEC Management Centre has the same status as the official versions.

CENELEC members are the national electrotechnical committees of Austria, Belgium, Bulgaria, Croatia, Cyprus, the Czech Republic, Denmark, Estonia, Finland, Former Yugoslav Republic of Macedonia, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, the Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and the United Kingdom.



European Committee for Electrotechnical Standardization
Comité Européen de Normalisation Electrotechnique
Europäisches Komitee für Elektrotechnische Normung

CEN-CENELEC Management Centre: Avenue Marnix 17, B-1000 Brussels

Contents

	Page
European foreword	5
Introduction	6
1 Scope	9
2 Normative references	9
3 Terms, definitions and abbreviations	9
3.1 Terms and definitions	9
3.2 Abbreviations.....	10
3.3 Symbols.....	11
4 Applicable area of the data centre	11
5 Determination of Power Usage Effectiveness.....	12
5.1 General.....	12
5.2 Total data centre energy consumption.....	12
5.3 Total data centre energy consumption in mixed-use buildings	13
6 Measurement of Power Usage Effectiveness	13
6.1 Measuring energy consumption.....	13
6.1.1 General.....	13
6.1.2 Measurement period and frequency	13
6.1.3 Meter and measurement requirements.....	13
6.2 Categories of Power Usage Effectiveness.....	14
6.2.1 General.....	14
6.2.2 Category 1 (PUE ₁) – basic resolution.....	14
6.2.3 Category 2 (PUE ₂) – intermediate resolution	15
6.2.4 Category 3 (PUE ₃) – advanced resolution	15
6.2.5 Measurement placement.....	15
7 Reporting of Power Usage Effectiveness	15
7.1 Requirements	15
7.1.1 Standard construct for communicating PUE data.....	15
7.1.2 Example of reporting PUE values	15
7.1.3 Data for public reporting PUE	16
7.2 Recommendations	16
7.2.1 Use of PUE Category.....	16
7.2.2 Trend tracking data	16
Annex A (normative) Energy measurements	18
A.1 Measuring energy and calculating Power Usage Effectiveness	18
A.2 Measurement locations	18

A.3	Assessment frequencies	19
Annex B (informative)	Calculation of PUE using various energy supplies	20
B.1	Examples of PUE calculation with various energy supplies.....	20
B.2	Examples of PUE calculation with cogeneration using electricity and natural gas	21
B.3	Examples of PUE calculation with absorption type chiller	22
Annex C (normative)	PUE derivatives.....	24
C.1	General.....	24
C.1.1	Purpose of PUE derivatives	24
C.1.2	Using PUE derivatives	24
C.2	Interim PUE	25
C.3	Partial PUE (pPUE)	25
C.3.1	General.....	25
C.3.2	Zoning	26
C.3.3	Metering requirements for pPUE	27
C.3.4	Reporting of pPUE	27
C.3.5	Use of pPUE in energy management	28
C.3.6	Use of pPUE in mixed use buildings.....	28
C.4	Designed PUE	29
Annex D (informative)	Interpretation of PUE and its derivatives	32
D.1	General.....	32
D.2	Data centre infrastructure versus IT equipment.....	32
D.3	Comparing PUE results between data centres	33
Bibliography	34

Figures

Figure 1 — Schematic relationship between the EN 50600 series of documents	7
Figure A.1 — Schematic of PUE calculation from measurements.....	18
Figure A.2 — Monitoring and measurement points.....	19
Figure B.1 — Example for a data centre purchasing all electricity.....	20
Figure B.2 — Example for a data centre purchasing electricity and chilled water	20
Figure B.3 — Example for a data centre purchasing natural gas	21
Figure B.4 — Example for a data centre purchasing electricity and natural gas	21
Figure B.5 — Method 1: Measured by chilled water flow.....	22
Figure B.6 — Method 2: Calculated from energy required to produce chilled water	22
Figure B.7 — Method 1: Measured by chilled water flow.....	22
Figure B.8 — Method 2: Measured by input gas.....	23
Figure C.1 — Zoning for a data centre	26
Figure C.2 — Zoning for a data centre using DX cooling.....	27
Figure C.3 — Zoning for a data centre using water	27
Figure C.4 — Example of utilizing the combination of PUE derivatives: ipPUE	28

Tables

Table 1 — PUE Categories	14
Table 2 — Examples of PUE reporting	15
Table C.1 — Example of dPUE calculation.....	30
Table C.2 — Example of context description	31

European foreword

This document (EN 50600-4-2:2016) has been prepared by CLC/TC 215 “Electrotechnical aspects of telecommunication equipment”.

The following dates are fixed:

- latest date by which this document has (dop) [2017-07-10]
to be implemented at national level by publication of an identical national standard or by endorsement
- latest date by which the national standards conflicting with this document have to be withdrawn (dow) [2019-10-10]

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. CENELEC [and/or CEN] shall not be held responsible for identifying any or all such patent rights.

This document has been prepared under a mandate given to CENELEC by the European Commission and the European Free Trade Association.

Regarding the various parts in the EN 50600 series, see the Introduction.

Introduction

The unrestricted access to internet-based information demanded by the information society has led to an exponential growth of both internet traffic and the volume of stored/retrieved data. Data centres are housing and supporting the information technology and network telecommunications equipment for data processing, data storage and data transport. They are required both by network operators (delivering those services to customer premises) and by enterprises within those customer premises.

Data centres need to provide modular, scalable and flexible facilities and infrastructures to easily accommodate the rapidly changing requirements of the market. In addition, energy consumption of data centres has become critical both from an environmental point of view (reduction of carbon footprint) and with respect to economic considerations (cost of energy) for the data centre operator.

The implementation of data centres varies in terms of:

- a) purpose (enterprise, co-location, co-hosting, or network operator facilities);
- b) security level;
- c) physical size;
- d) accommodation (mobile, temporary and permanent constructions).

The needs of data centres also vary in terms of availability of service, the provision of security and the objectives for energy efficiency. These needs and objectives influence the design of data centres in terms of building construction, power distribution, environmental control and physical security. Effective management and operational information is required to monitor achievement of the defined needs and objectives.

This series of European Standards specifies requirements and recommendations to support the various parties involved in the design, planning, procurement, integration, installation, operation and maintenance of facilities and infrastructures within data centres. These parties include:

- 1) owners, facility managers, ICT managers, project managers, main contractors;
- 2) architects, consultants, building designers and builders, system and installation designers;
- 3) facility and infrastructure integrators, suppliers of equipment;
- 4) installers, maintainers.

At the time of publication of this European Standard, the EN 50600 series will comprise the following standards and documents:

- EN 50600-1, *Information technology — Data centre facilities and infrastructures — Part 1: General concepts*;
- EN 50600-2-1, *Information technology — Data centre facilities and infrastructures — Part 2-1: Building construction*;
- EN 50600-2-2, *Information technology — Data centre facilities and infrastructures — Part 2-2: Power distribution*;
- EN 50600-2-3, *Information technology — Data centre facilities and infrastructures — Part 2-3: Environmental control*;
- EN 50600-2-4, *Information technology — Data centre facilities and infrastructures — Part 2-4: Telecommunications cabling infrastructure*;

- EN 50600-2-5, *Information technology — Data centre facilities and infrastructures — Part 2-5: Security systems;*
- EN 50600-3-1, *Information technology — Data centre facilities and infrastructures — Part 3-1: Management and operational information;*
- EN 50600-4-1, *Information technology — Data centre facilities and infrastructures — Part 4-1: Overview of and general requirements for key performance indicators;*
- EN 50600-4-2, *Information technology — Data centre facilities and infrastructures — Part 4-2: Power Usage Effectiveness;*
- EN 50600-4-3, *Information technology — Data centre facilities and infrastructures — Part 4-3: Renewable Energy Factor;*
- CLC/TR 50600-99-1, *Information technology — Data centre facilities and infrastructures — Part 99-1: Recommended practices for energy management.*

The inter-relationship of the standards within the EN 50600 series is shown in Figure 1.

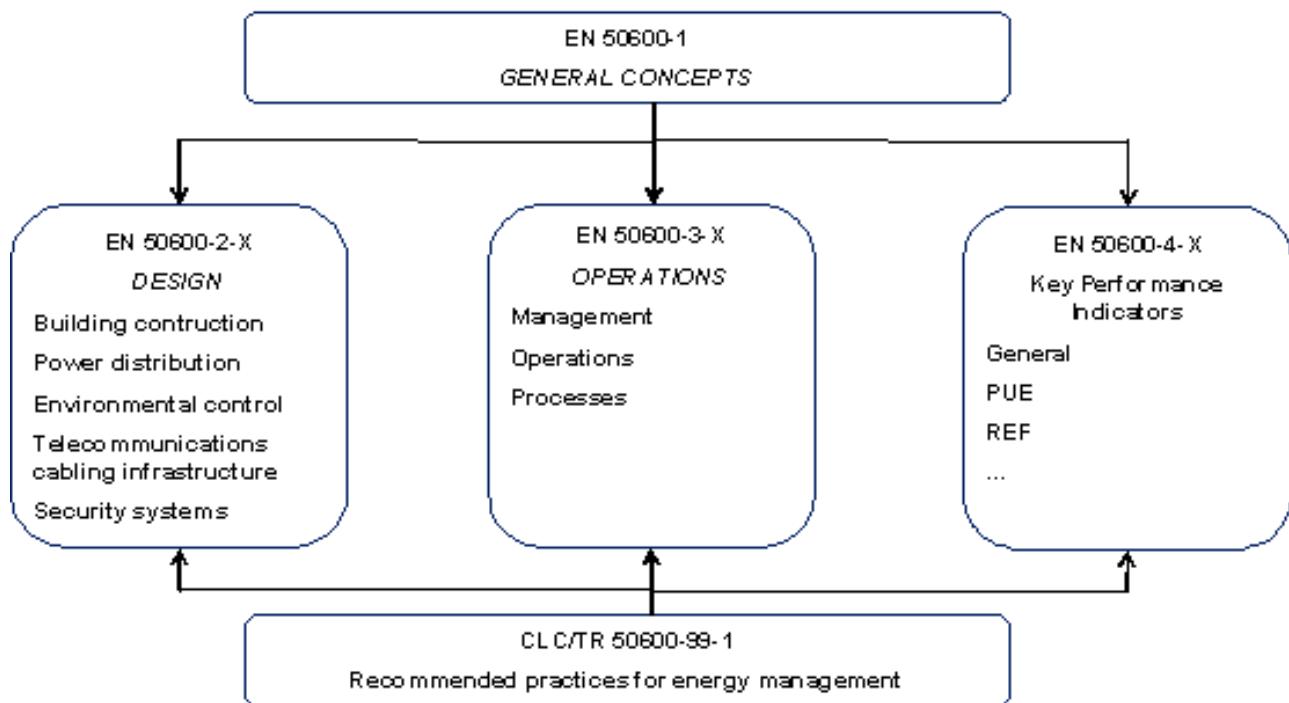


Figure 1 — Schematic relationship between the EN 50600 series of documents

EN 50600-2-X standards specify requirements and recommendations for particular facilities and infrastructures to support the relevant classification for “availability”, “physical security” and “energy efficiency enablement” selected from EN 50600-1.

EN 50600-3-X documents specify requirements and recommendations for data centre operations, processes and management.

EN 50600-4-X documents specify requirements and recommendations for key performance indicators (KPIs) used to assess and improve the resource usage efficiency and effectiveness, respectively, of a data centre.

In today's digital society data centre growth, and power consumption in particular, is an inevitable consequence and that growth will demand increasing power consumption despite the most stringent energy efficiency strategies. This makes the need for key performance indicators that cover the effective use of resources (including but not limited to energy) and the reduction of CO₂ emissions essential.

NOTE Within the EN 50600–4-X series, the term “resource usage effectiveness” is more generally used for KPIs in preference to “resource usage efficiency”, which is restricted to situations where the input and output parameters used to define the KPI have the same units.

In order to enable the optimum resource effectiveness of data centres a suite of effective KPIs is needed to measure and report on resources consumed in order to develop an improvement roadmap.

These standards are intended to accelerate the provision of operational infrastructures with improved resource usage effectiveness.

This European Standard specifies Power Usage Effectiveness (PUE), which has become a popular metric to determine the efficient utilization and distribution of energy resources within a data centre.

It is recognized that the term “efficiency” should be employed for PUE but “effectiveness” provides continuity with earlier market recognition of the term.

Additional standards in the EN 50600-4-X series will be developed, each describing a specific KPI for resource usage effectiveness or efficiency.

The EN 50600-4-X series does not specify limits or targets for any KPI and does not describe or imply, unless specifically stated, any form of aggregation of individual KPIs into a combined nor an overall KPI for data centre resource usage effectiveness or efficiency.

This European Standard is intended for use by and collaboration between data centre managers, facility managers, ICT managers, and main contractors.

This series of European Standards does not address the selection of information technology and network telecommunications equipment, software and associated configuration issues.

1 Scope

This European Standard specifies the Power Usage Effectiveness (PUE) as a Key Performance Indicator (KPI) to quantify the efficient use of energy in the form of electricity.

NOTE See the Note 1 to entry in Definition 3.1.3.

This European Standard:

- a) defines the Power Usage Effectiveness (PUE) of a data centre;
- b) introduces PUE measurement categories;
- c) describes the relationship of this KPI to a data centre's infrastructure, information technology equipment and information technology operations;
- d) defines the measurement, the calculation and the reporting of the parameter;
- e) provides information on the correct interpretation of the PUE.

PUE derivatives are described in Annex C.

2 Normative references

The following documents, in whole or in part, are normatively referenced in this document and are indispensable for its application. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

EN 50600-1, *Information technology — Data centre facilities and infrastructures — Part 1: General concepts*

EN 50600-4-1:2016, *Information technology — Data centre facilities and infrastructures — Part 4-1: Overview of and general requirements for key performance indicators*

EN 62052 (all parts), *Electricity metering equipment (AC) — General requirements, tests and test conditions (IEC 62052 series)*

EN 62053 (all parts), *Electricity metering equipment (a.c.) — Particular requirements (IEC 62053 series)*