

© Copyright SEK Svensk Elstandard. Reproduction in any form without permission is prohibited.

Mättransformatorer – Del 13: Tilläggsfordringar för fristående sammanslagningsenheter (SAMU)

*Instrument transformers –
Part 13: Stand-alone merging unit (SAMU)*

Som svensk standard gäller europastandarden EN IEC 61869-13:2021. Den svenska standarden innehåller den officiella engelska språkversionen av EN IEC 61869-13:2021.

Nationellt förord

Europastandarden EN IEC 61869-13:2021

består av:

- **europastandardens ikraftsättningsdokument**, utarbetat inom CENELEC
- **IEC 61869-13, First edition, 2021 - Instrument transformers - Part 13: Stand-alone merging unit (SAMU)**

utarbetad inom International Electrotechnical Commission, IEC.

Standarden ska användas tillsammans med SS-EN IEC 61869-9, utgåva 1, 2019, SS-EN 61869-6, utgåva 1, 2017 och SS-EN 61869-1, utgåva 1, 2009.

Standarder underlättar utvecklingen och höjer elsäkerheten

Det finns många fördelar med att ha gemensamma tekniska regler för bl a mätning, säkerhet och provning och för utförande, skötsel och dokumentation av elprodukter och elanläggningar.

Genom att utforma sådana standarder blir säkerhetsfordringar tydliga och utvecklingskostnaderna rimliga samtidigt som marknadens acceptans för produkten eller tjänsten ökar.

Många standarder inom elområdet beskriver tekniska lösningar och metoder som åstadkommer den elsäkerhet som föreskrivs av svenska myndigheter och av EU.

SEK är Sveriges röst i standardiseringsarbetet inom elområdet

SEK Svensk Elstandard svarar för standardiseringen inom elområdet i Sverige och samordnar svensk medverkan i internationell och europeisk standardisering. SEK är en ideell organisation med frivilligt deltagande från svenska myndigheter, företag och organisationer som vill medverka till och påverka utformningen av tekniska regler inom elektrotekniken.

SEK samordnar svenska intressenters medverkan i SEKs tekniska kommittéer och stödjer svenska experters medverkan i internationella och europeiska projekt.

Stora delar av arbetet sker internationellt

Utformningen av standarder sker i allt väsentligt i internationellt och europeiskt samarbete. SEK är svensk nationalkommitté av International Electrotechnical Commission (IEC) och Comité Européen de Normalisation Electrotechnique (CENELEC).

Standardiseringsarbetet inom SEK är organiserat i referensgrupper bestående av ett antal tekniska kommittéer som speglar hur arbetet inom IEC och CENELEC är organiserat.

Arbetet i de tekniska kommittéerna är öppet för alla svenska organisationer, företag, institutioner, myndigheter och statliga verk. Den årliga avgiften för deltagandet och intäkter från försäljning finansierar SEKs standardiseringsverksamhet och medlemsavgift till IEC och CENELEC.

Var med och påverka!

Den som deltar i SEKs tekniska kommittéarbete har möjlighet att påverka framtida standarder och får tidig tillgång till information och dokumentation om utvecklingen inom sitt teknikområde. Arbetet och kontakterna med kollegor, kunder och konkurrenter kan gynnsamt påverka enskilda företags affärsutveckling och bidrar till deltagarnas egen kompetensutveckling.

Du som vill dra nytta av dessa möjligheter är välkommen att kontakta SEKs kansli för mer information.

SEK Svensk Elstandard

Box 1284
164 29 Kista
Tel 08-444 14 00
www.elstandard.se

English Version

**Instrument transformers - Part 13: Stand-alone merging unit
(SAMU)
(IEC 61869-13:2021)**

Transformateurs de mesure - Partie 13: Concentrateur
autonome (SAMU)
(IEC 61869-13:2021)

Messwandler - Teil 13: Unabhängige Merging Unit
(IEC 61869-13:2021)

This European Standard was approved by CENELEC on 2021-03-10. CENELEC members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration.

Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the CEN-CENELEC Management Centre or to any CENELEC member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CENELEC member into its own language and notified to the CEN-CENELEC Management Centre has the same status as the official versions.

CENELEC members are the national electrotechnical committees of Austria, Belgium, Bulgaria, Croatia, Cyprus, the Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, the Netherlands, Norway, Poland, Portugal, Republic of North Macedonia, Romania, Serbia, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and the United Kingdom.



European Committee for Electrotechnical Standardization
Comité Européen de Normalisation Electrotechnique
Europäisches Komitee für Elektrotechnische Normung

CEN-CENELEC Management Centre: Rue de la Science 23, B-1040 Brussels

European foreword

The text of document 38/634/FDIS, future edition 1 of IEC 61869-13, prepared by IEC/TC 38 "Instrument transformers" was submitted to the IEC-CENELEC parallel vote and approved by CENELEC as EN IEC 61869-13:2021.

The following dates are fixed:

- latest date by which the document has to be implemented at national (dop) 2022-01-16 level by publication of an identical national standard or by endorsement
- latest date by which the national standards conflicting with the (dow) 2024-07-16 document have to be withdrawn

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. CENELEC shall not be held responsible for identifying any or all such patent rights.

This document has been prepared under a mandate given to CENELEC by the European Commission and the European Free Trade Association.

Any feedback and questions on this document should be directed to the users' national committee. A complete listing of these bodies can be found on the CENELEC website.

Endorsement notice

The text of the International Standard IEC 61869-13:2021 was approved by CENELEC as a European Standard without any modification.

In the official version, for Bibliography, the following notes have to be added for the standards indicated:

IEC 60255 series	NOTE Harmonized as EN 60255 series
IEC 60255-1	NOTE Harmonized as EN 60255-1
IEC 60255-21-1	NOTE Harmonized as EN 60255-21-1
IEC 60255-21-2	NOTE Harmonized as EN 60255-21-2
IEC 60255-21-3	NOTE Harmonized as EN 60255-21-3
IEC 60255-26:2013	NOTE Harmonized as EN 60255-26:2013 (not modified)
IEC 61000-6-5	NOTE Harmonized as EN 61000-6-5
IEC 61850-9-2	NOTE Harmonized as EN 61850-9-2
IEC 61869-3	NOTE Harmonized as EN 61869-3
IEC 61869-4	NOTE Harmonized as EN 61869-4
IEC 61869-5	NOTE Harmonized as EN 61869-5
IEC 62052 series	NOTE Harmonized as EN 62052 series
IEC 62053 series	NOTE Harmonized as EN 62053 series

IEC 62053-22	NOTE Harmonized as EN IEC 62053-22
IEC 62271 series	NOTE Harmonized as EN 62271 series
IEC 62271-1	NOTE Harmonized as EN 62271-1
IEC 62271-3	NOTE Harmonized as EN 62271-3

Annex ZA (normative)

Normative references to international publications with their corresponding European publications

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

NOTE 1 Where an International Publication has been modified by common modifications, indicated by (mod), the relevant EN/HD applies.

NOTE 2 Up-to-date information on the latest versions of the European Standards listed in this annex is available here: www.cenelec.eu.

<u>Publication</u>	<u>Year</u>	<u>Title</u>	<u>EN/HD</u>	<u>Year</u>
IEC 60068-2-1	2007	Environmental testing - Part 2-1: Tests Test A: Cold	-EN 60068-2-1	2007
IEC 60068-2-2	2007	Environmental testing - Part 2-2: Tests Test B: Dry heat	-EN 60068-2-2	2007
IEC 60068-2-14	2009	Environmental testing - Part 2-14: Tests Test N: Change of temperature	-EN 60068-2-14	2009
IEC 60068-2-30	2005	Environmental testing - Part 2-30: Tests Test Db: Damp heat, cyclic (12 h + 12 h cycle)	-EN 60068-2-30	2005
IEC 60068-2-78	2012	Environmental testing - Part 2-78: Tests Test Cab: Damp heat, steady-state	-EN 60068-2-78	2013
IEC 60255-27	2013	Measuring relays and protection equipment - Part 27: Product safety requirements	EN 60255-27	2014
IEC 60664-1	2020	Insulation coordination for equipment within low-voltage supply systems - Part 1: Principles, requirements and tests	EN IEC 60664-1	2020
IEC 61000-4-2	2008	Electromagnetic compatibility (EMC) - Part 4-2: Testing and measurement techniques - Electrostatic discharge immunity test	EN 61000-4-2	2009
IEC 61000-4-3	2006	Electromagnetic compatibility (EMC) - Part 4-3: Testing and measurement techniques - Radiated, radio-frequency, electromagnetic field immunity test	EN 61000-4-3	2006
+ A1	2007		+ A1	2008
+ A2	2010		+ A2	2010
IEC 61000-4-4	2012	Electromagnetic compatibility (EMC) - Part 4-4: Testing and measurement techniques - Electrical fast transient/burst immunity test	EN 61000-4-4	2012

IEC 61000-4-5	2014	Electromagnetic compatibility (EMC) - Part 4-5: Testing and measurement techniques - Surge immunity test	EN 61000-4-5	2014
IEC 61000-4-6	2013	Electromagnetic compatibility (EMC) - Part 4-6: Testing and measurement techniques - Immunity to conducted disturbances, induced by radio-frequency fields	EN 61000-4-6	2014
IEC 61000-4-8	2009	Electromagnetic compatibility (EMC) - Part 4-8: Testing and measurement techniques - Power frequency magnetic field immunity test	EN 61000-4-8	2010
IEC 61000-4-9	2016	Electromagnetic compatibility (EMC) - Part 4-9: Testing and measurement techniques - Impulse magnetic field immunity test	EN 61000-4-9	2016
IEC 61000-4-10	2016	Electromagnetic compatibility (EMC) - Part 4-10: Testing and measurement techniques - Damped oscillatory magnetic field immunity test	EN 61000-4-10	2017
IEC 61000-4-11	2020	Electromagnetic compatibility (EMC) - Part 4-11: Testing and measurement techniques - Voltage dips, short interruptions and voltage variations immunity tests for equipment with input current up to 16 A per phase	EN IEC 61000-4-11	2020
IEC 61000-4-13	-	Electromagnetic compatibility (EMC) - Part 4-13: Testing and measurement techniques - Harmonics and interharmonics including mains signalling at a.c. power port, low frequency immunity tests	EN 61000-4-13	-
IEC 61000-4-16	2015	Electromagnetic compatibility (EMC) - Part 4-16: Testing and measurement techniques - Test for immunity to conducted, common mode disturbances in the frequency range 0 Hz to 150 kHz	EN 61000-4-16	2016
IEC 61000-4-17	1999	Electromagnetic compatibility (EMC) - Part 4-17: Testing and measurement techniques - Ripple on d.c. input power port immunity test	EN 61000-4-17	1999
+ A1	2001		+ A1	2004
+ A2	2008		+ A2	2009
IEC 61000-4-18	2006	Electromagnetic compatibility (EMC) - Part 4-18: Testing and measurement techniques - Damped oscillatory wave immunity test	EN 61000-4-18	2007
-	-		+ corrigendum	Sep. 2007
+ A1	2010		+ A1	2010
IEC 61000-4-29	2000	Electromagnetic compatibility (EMC) - Part 4-29: Testing and measurement techniques - Voltage dips, short interruptions and voltage variations on d.c. input power port immunity tests	EN 61000-4-29	2000

EN IEC 61869-13:2021 (E)

IEC 61850-7-4	-	Communication networks and systems for power utility automation - Part 7-4: Basic communication structure - Compatible logical node classes and data object classes	EN 61850-7-4	-
IEC 61869-1 (mod)	2007	Instrument transformers - Part 1: General requirements	EN 61869-1	2009
IEC 61869-2	2012	Instrument transformers - Part 2: Additional requirements for current transformers	EN 61869-2	2012
IEC 61869-6	2016	Instrument transformers - Part 6: Additional general requirements for low-power instrument transformers	EN 61869-6	2016
IEC 61869-9	2016	Instrument transformers - Part 9: Digital interface for instrument transformers	EN IEC 61869-9	2019
IEC 61869-10	2017	Instrument transformers - Part 10: Additional requirements for low-power passive current transformers	EN IEC 61869-10	2018
IEC 61869-11	2017	Instrument transformers - Part 11: Additional requirements for low-power passive voltage transformers	EN IEC 61869-11	2018
CISPR 11	-	Industrial, scientific and medical equipment - Radio-frequency disturbance characteristics - Limits and methods of measurement	EN 55011	-
CISPR 32	2015	Electromagnetic compatibility of multimedia equipment - Emission requirements	EN 55032	2015
+ A1	2019		+ A1	2020
-	-		+ A11	2020

INTERNATIONAL STANDARD

NORME INTERNATIONALE



**Instrument transformers –
Part 13: Stand-alone merging unit (SAMU)**

**Transformateurs de mesure –
Partie 13: Concentrateur autonome (SAMU)**

INTERNATIONAL
ELECTROTECHNICAL
COMMISSION

COMMISSION
ELECTROTECHNIQUE
INTERNATIONALE

ICS 17.220.20

ISBN 978-2-8322-9284-6

<p>Warning! Make sure that you obtained this publication from an authorized distributor.</p> <p>Attention! Veuillez vous assurer que vous avez obtenu cette publication via un distributeur agréé.</p>
--

CONTENTS

FOREWORD.....	4
INTRODUCTION.....	7
1 Scope.....	9
2 Normative references	9
3 Terms and definitions	11
4 Normal and special service conditions	14
5 Ratings.....	15
6 Design and construction	23
7 Tests	32
8 Rules for transport, storage, erection, operation and maintenance.....	49
9 Safety.....	49
Annex 13A (informative) Measurement chain accuracy class considerations	50
Annex 13B (informative) Measurement examples of switching and lightning surge voltage in gas-insulated switchgear	52
Annex 13C (normative) Low-power instrument transformer inputs	63
Bibliography.....	67
Figure 1301 – Stand-alone merging unit (functional concept example).....	7
Figure 1302 – Stand-alone merging unit application example.....	7
Figure 1303 – Illustration of the SAMU position in relation to other devices and standards in the functional chain.....	8
Figure 1304 – Specified input current time constant T_I	13
Figure 1305 – Dynamic range concept example	19
Figure 604 (modified) – Examples of subassembly subjected to EMC tests – Usual structure used in HV AIS applications	34
Figure 1306 – Gradual shutdown – Startup test	38
Figure 1307 – C-O-C-O duty cycle	39
Figure 13A.1 – SAMU application example	50
Figure 13B.1 – Constructional example of GIS with typical surge voltage sources.....	52
Figure 13B.2 – Measured 550 kV GIS construction	53
Figure 13B.3 – Measurement results showing a switching surge peak voltage magnitude caused by the DS operation in Figure 13B.2	54
Figure 13B.4 – Measured 275 kV GIS construction	55
Figure 13B.5 – Switching and lightning surge voltage waveforms.....	56
Figure 13B.6 – Switching surge voltage measurement setup on a 550 kV GIS with/without an insulating flange surge absorber	57
Figure 13B.7 – Switching surge voltage measurement results when the DS was operated with/without the surge absorber.....	58
Figure 13B.8 – CT secondary circuit configuration for the 500 kV GIS	59
Figure 13B.9 – DS control circuit configuration for the 500 kV GIS test.....	59
Figure 13B.10 – Waveforms of switching surge voltage at measured point I (see Table 13B.3).....	60
Figure 13B.11 – Block diagram of the electronic VT with amplifier tested in the 500 kV GIS system	61

Figure 13B.12 – Lightning surge voltage as a function of surge absorbing capacitor value...61

Figure 13B.13 – Lightning surge voltage as a function of coaxial cable length62

Table 1301 – Insulation requirements for analogue inputs..... 16

Table 1302 – Measuring accuracy class 0,05..... 17

Table 1303 – Limits of current error and phase error for SAMU measuring accuracy
current channels 18

Table 1304 – Limits of current errors for SAMU TPM class rated protection accuracy
current channels 20

Table 1305 – Limits of voltage error and phase error for SAMU voltage channels 21

Table 1306 – SAMU TCTR class settings..... 23

Table 1307 – SAMU TVTR class settings..... 23

Table 1308 – Immunity requirements and tests 24

Table 1309 – Acceptance criteria for EMC immunity tests 25

Table 1310 – Radiated emissions tests 27

Table 1311 – Conducted emissions tests 27

Table 1312 – SAMU rating plate markings 28

Table 1313 – Ratings defined in accordance with IEC 61850-7-4 32

Table 10 – List of tests..... 33

Table 1314 – Dry-heat test – Operational..... 44

Table 1315 – Cold test – Operational..... 44

Table 1316 – Dry-heat test at maximum storage temperature 45

Table 1317 – Cold test at minimum storage temperature..... 45

Table 1318 – Change of temperature (Cyclic temperature test)..... 46

Table 1319 – Damp heat steady state test 47

Table 1320 – Cyclic temperature with humidity test..... 48

Table 13A.1 – Combined accuracy class table 50

Table 13B.1 – Measurement results showing switching and lightning surge voltage
recorded for the setup in Figure 13B.4 55

Table 13B.2 – Measurement results of switching surge voltage on CT secondary circuit..... 59

Table 13B.3 – Measurement results showing the switching surge voltage coupling to
the DS control circuit 59

Table 13C.1 – ITRat setting units..... 65

Table 13C.2 – SAMU rating plate marking modifications 65

INTERNATIONAL ELECTROTECHNICAL COMMISSION

INSTRUMENT TRANSFORMERS –

Part 13: Stand-alone merging unit (SAMU)

FOREWORD

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

International Standard IEC 61869-13 has been prepared by IEC technical committee 38: Instrument transformers.

The text of this International Standard is based on the following documents:

FDIS	Report on voting
38/634/FDIS	38/640/RVD

Full information on the voting for the approval of this International Standard can be found in the report on voting indicated in the above table.

This document has been drafted in accordance with the ISO/IEC Directives, Part 2.

A list of all parts in the IEC 61869 series, published under the general title *Instrument transformers*, can be found on the IEC website.

This Part 13 is to be used in conjunction with IEC 61869-9:2016, *Digital interface for instrument transformers*, and IEC 61869-6:2016, *Additional general requirements for low-power instrument transformers*, which, in turn, are based on IEC 61869-1:2007, *General requirements*.

This Part 13 follows the structure of IEC 61869-1:2007 and IEC 61869-6:2016 and supplements or modifies their corresponding clauses.

When a particular clause/subclause of Part 1 or Part 6 is not mentioned in this Part 13, that subclause applies. When this document states "addition", "modification" or "replacement", the relevant text in Part 1 or Part 6 is to be adapted accordingly.

For additional clauses, subclauses, figures, tables, annexes or note, the following numbering system is used:

- clauses, subclauses, tables, figures and notes that are numbered starting from 1301 are additional to those in Part 1 and Part 6;
- additional annexes are lettered 13A, 13B, etc.

An overview of the planned set of standards at the date of publication of this document is given below. The updated list of standards issued by IEC TC 38 is available at the website: www.iec.ch.

PRODUCT FAMILY STANDARDS IEC	PRODUCT STANDARD IEC	PRODUCTS	OLD STANDARD IEC
61869-1 GENERAL REQUIREMENTS FOR INSTRUMENT TRANSFORMERS	61869-2	ADDITIONAL REQUIREMENTS FOR CURRENT TRANSFORMERS	60044-1 60044-6
	61869-3	ADDITIONAL REQUIREMENTS FOR INDUCTIVE VOLTAGE TRANSFORMERS	60044-2
	61869-4	ADDITIONAL REQUIREMENTS FOR COMBINED TRANSFORMERS	60044-3
	61869-5	ADDITIONAL REQUIREMENTS FOR CAPACITOR VOLTAGE TRANSFORMERS	60044-5
	61869-6 ADDITIONAL GENERAL REQUIREMENTS FOR LOW-POWER INSTRUMENT TRANSFORMERS	61869-7	60044-7
		61869-8	60044-8
		61869-9	
		61869-10	
		61869-11	60044-7
		61869-12	
		61869-13	
		61869-14	
		61869-15	

The committee has decided that the contents of this document will remain unchanged until the stability date indicated on the IEC website under "<http://webstore.iec.ch>" in the data related to the specific document. At this date, the document will be

- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

IMPORTANT – The "colour inside" logo on the cover page of this document indicates that it contains colours which are considered to be useful for the correct understanding of its contents. Users should therefore print this document using a colour printer.

INTRODUCTION

General

This document is an IEC 61869 series product standard which defines additional requirements for a stand-alone merging unit (SAMU).

The general block diagram showing a typical SAMU application example is given in Figure 1301.

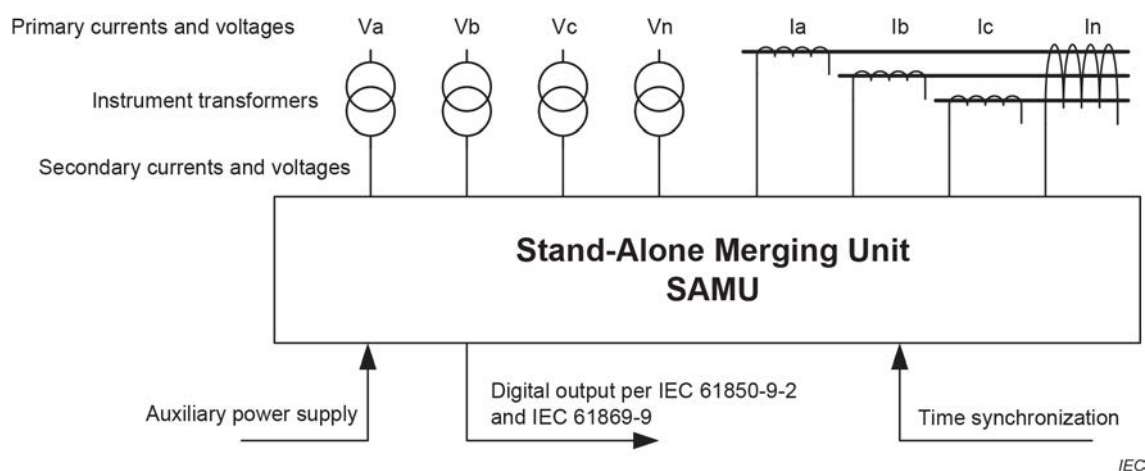


Figure 1301 – Stand-alone merging unit (functional concept example)

An application example showing a three-phase dead tank circuit breaker equipped with bushing type current transformers and a stand-alone merging unit mounted inside the breaker control cabinet is shown in Figure 1302.

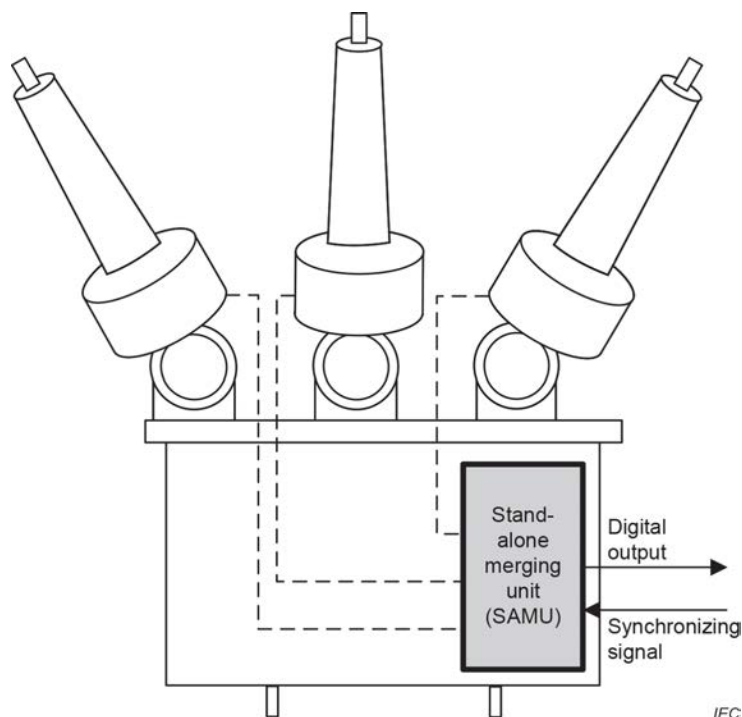


Figure 1302 – Stand-alone merging unit application example

The SAMU output may be used by many devices and is therefore of interest to multiple technical committees in addition to TC 38, for example: TC 57: Power systems management and

associated information exchange, TC 95: Measuring relays and protection equipment, TC 13: Electrical energy measurement and control, TC 85: Measuring equipment for electrical and electromagnetic quantities, and TC 17: High-voltage switchgear and controlgear, as shown in Figure 1303.

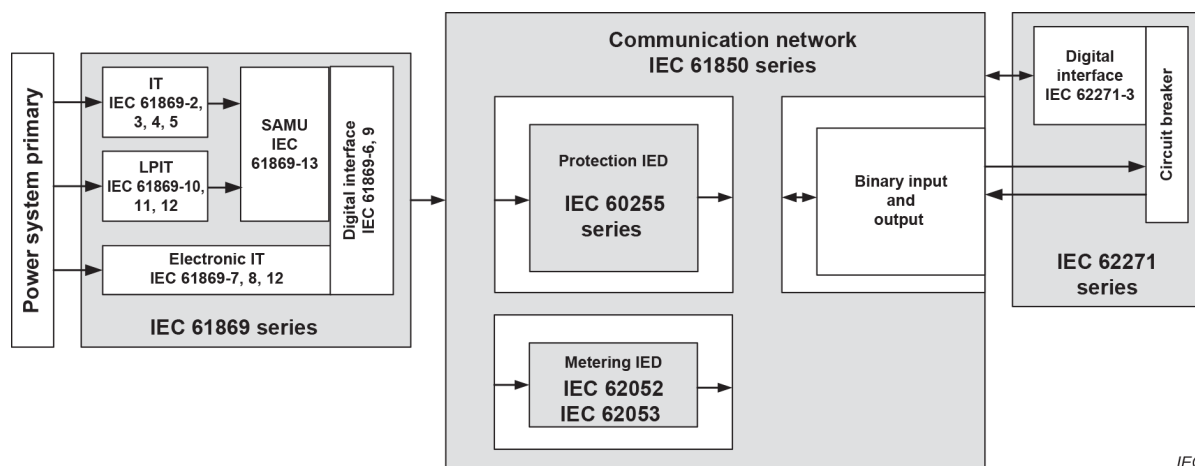


Figure 1303 – Illustration of the SAMU position in relation to other devices and standards in the functional chain

Position of this document in relation to IEC 61850 (all parts) of TC 57

IEC 61850 (all parts) is a series used to define various aspects of power utility communications. Its applicability to this document is inherited through IEC 61869-9 which defines applicable sample rates and a digital interface in accordance with IEC 61850-9-2 and related standards.

Position of this document in relation to IEC 60255 (all parts) of TC 95

IEC 60255 (all parts) standardizes the design and performance aspects applicable to measuring relays and protection equipment used in the various fields of electrical engineering. Since the SAMU is an integral part of the digital substation-based protection system, its EMC performance and environmental aspects are considered for harmonization with IEC 60255-1, IEC 60255-26 and safety aspects defined in IEC 60255-27. SAMU outputs are inputs for protection functions covered by the IEC 60255-1xx series.

Position of this document in relation to IEC 62052 (all parts) and IEC 62053 (all parts) of TC 13

IEC 62052 (all parts) and IEC 62053 (all parts) provide standardization in the field of AC and DC electrical energy measurement and control. Since the SAMU digital output may be used as input to energy measurement devices, its accuracy and EMC performance aspects should be considered.

Position of this document in relation to IEC 62271 (all parts) of TC 17

IEC 62271 (all parts) applies to AC switchgear and controlgear designed for indoor and/or outdoor installation and for operation at service frequencies up to and including 60 Hz on systems having rated voltages above 1 000 V. Similar to IEC 62271-3 which defines the switchgear interface based on IEC 61850, this document defines the SAMU which may be installed inside the same switchgear cabinet and is therefore subject to the same environmental stress.

INSTRUMENT TRANSFORMERS –

Part 13: Stand-alone merging unit (SAMU)

1 Scope

Clause 1 of IEC 61869-1:2007 is replaced by the following:

This part of IEC 61869 is a product standard and covers only additional requirements for stand-alone merging units (SAMUs) used for AC applications having rated frequencies from 15 Hz to 100 Hz. The digital output format specification is not covered by this document; it is standardized in IEC 61869-9 as an application of IEC 61850, which specifies the power utility communication architecture.

This document covers SAMUs having standardized analogue inputs (for example: 1 A, 5 A, 3,25 V / $\sqrt{3}$ or 100 V / $\sqrt{3}$) provided by instrument transformers compliant with relevant product standards (e.g. IEC 61869-2 to IEC 61869-5, IEC 61869-7, IEC 61869-8, IEC 61869-10, IEC 61869-11, IEC 60044-1 to IEC 60044-6, IEC 60185, IEC 60186, IEEE C57.13), and aims to convert them to the digital output compliant with IEC 61869-9. Other input and output types are outside the scope of this document. Appropriate SAMU functionality can be combined with switchgear controller functionality defined in IEC 62271-3 or other IED functionality defined in IEC 60255 (all parts).

Cyber security requirements are outside the scope of this document and are covered by the IEC 62351 series.

2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

Clause 2 of IEC 61869-1:2007 is applicable with the following additions:

IEC 60068-2-1:2007, *Environmental testing – Part 2-1: Tests – Test A: Cold*

IEC 60068-2-2:2007, *Environmental testing – Part 2-2: Tests – Test B: Dry heat*

IEC 60068-2-14:2009, *Environmental testing – Part 2-14: Tests – Test N: Change of temperature*

IEC 60068-2-30:2005, *Environmental testing – Part 2-30: Tests – Test Db: Damp heat, cyclic (12 + 12 h cycle)*

IEC 60068-2-78:2012, *Environmental testing – Part 2-78: Tests – Test Cab: Damp heat, steady state*

IEC 60255-27:2013, *Measuring relays and protection equipment – Part 27: Product safety requirements*

IEC 60664-1:2020, *Insulation coordination for equipment within low-voltage supply systems – Part 1: Principles, requirements and tests*

IEC 61000-4-2:2008, *Electromagnetic compatibility (EMC) – Part 4-2: Testing and measurement techniques – Electrostatic discharge immunity test*

IEC 61000-4-3:2006, *Electromagnetic compatibility (EMC) – Part 4-3: Testing and measurement techniques – Radiated, radio-frequency, electromagnetic field immunity test*

IEC 61000-4-3:2006/AMD1:2007

IEC 61000-4-3:2006/AMD2:2010

IEC 61000-4-4:2012, *Electromagnetic compatibility (EMC) – Part 4-4: Testing and measurement techniques – Electrical fast transient/burst immunity test*

IEC 61000-4-5:2014, *Electromagnetic compatibility (EMC) – Part 4-5: Testing and measurement techniques – Surge immunity test*

IEC 61000-4-6:2013, *Electromagnetic compatibility (EMC) – Part 4-6: Testing and measurement techniques – Immunity to conducted disturbances, induced by radio-frequency fields*

IEC 61000-4-8:2009, *Electromagnetic compatibility (EMC) – Part 4-8 Testing and measurement techniques – Power frequency magnetic field immunity test*

IEC 61000-4-9:2016, *Electromagnetic compatibility (EMC) – Part 4-9 Testing and measurement techniques – Impulse magnetic field immunity test*

IEC 61000-4-10:2016, *Electromagnetic compatibility (EMC) – Part 4-10 Testing and measurement techniques – Damped oscillatory magnetic field immunity test*

IEC 61000-4-11:2020, *Electromagnetic compatibility (EMC) – Part 4-11 Testing and measurement techniques – Voltage dips, short interruptions and voltage variations immunity tests for equipment with input current up to 16 A per phase*

IEC 61000-4-13, *Electromagnetic compatibility (EMC) – Part 4-13: Testing and measurement techniques – Harmonics and interharmonics including mains signalling at a.c. power port, low frequency immunity tests*

IEC 61000-4-16:2015, *Electromagnetic compatibility (EMC) – Part 4-16 Testing and measurement techniques – Test for immunity to conducted, common mode disturbances in the frequency range 0 Hz to 150 kHz*

IEC 61000-4-17:1999, *Electromagnetic compatibility (EMC) – Part 4-17: Testing and measurement techniques – Ripple on d.c. input power port immunity test*

IEC 61000-4-17:1999/AMD1:2001

IEC 61000-4-17:1999/AMD1:2008

IEC 61000-4-18:2006, *Electromagnetic compatibility (EMC) – Part 4-18 Testing and measurement techniques – Damped oscillatory wave immunity test,*

IEC 61000-4-18:2006/AMD1:2010

IEC 61000-4-29:2000, *Electromagnetic compatibility (EMC) – Part 4-29 Testing and measurement techniques – Voltage dips, short interruptions and voltage variations on d.c. input power port immunity tests*

IEC 61850-7-4, *Communication networks and systems for power utility automation – Part 7-4: Basic communication structure – Compatible logical node classes and data object classes*

IEC 61869-1:2007, *Instrument transformers – Part 1: General requirements*

IEC 61869-2:2012, *Instrument transformers – Part 2: Additional requirements for current transformers*

IEC 61869-6:2016, *Instrument transformers – Part 6: Additional general requirements for low-power instrument transformers*

IEC 61869-9:2016, *Instrument transformers – Part 9: Digital interface for instrument transformers*

IEC 61869-10:2017, *Instrument transformers – Part 10: Additional requirements for low-power passive current transformers*

IEC 61869-11:2017, *Instrument transformers – Part 11: Additional requirements for low-power passive voltage transformers*

CISPR 11, *Industrial, scientific and medical equipment – Radio-frequency disturbance characteristics – Limits and methods of measurement*

CISPR 32:2015, *Electromagnetic compatibility of multimedia equipment – Emission requirements*

CISPR 32:2015/AMD1:2019