

© Copyright SEK Svensk Elstandard. Reproduction in any form without permission is prohibited.

Datahallsutrymmen och tillhörande system – Del 5-1: Mognadsmodell för energistyrning och miljömässig hållbarhet

*Information technology - Data centre facilities and infrastructures –
Part 5-1: Maturity Model for Energy Management and Environmental Sustainability
(CENELEC Technical Specification 50600-5-1:2023)*

Nationellt förord

En teknisk specifikation, TS, utarbetad inom CENELEC är avsedd att ge beskrivningar som kan stödja den inre marknads utveckling, ge vägledning beträffande specifikationer eller provningsmetoder eller ge specifikationer för teknikområden under snabb utveckling. Ett förslag till europeisk standard, EN, som det inte varit möjligt att nå tillräcklig enighet kring, kan också fastställas som TS, för att användas på försök (som förstandard) och för att efter eventuella justeringar eller bearbetningar senare fastställas som EN. En teknisk specifikation har en giltighetstid som är begränsad till tre år, med möjlighet till förlängning med tre eller högst sex år.

Tidigare fastställd svensk standard SEK TS 50600-5-1, utg 1:2022,
SEK Teknisk Rapport 50600-99-1, utg 5:2021 och SEK Teknisk Rapport 50600-99-2, utg 3:2021

ICS 35.020.00; 35.110.00; 35.160.00

Detta dokument är fastställt av SEK Svensk Elstandard, som också kan lämna upplysningar om **sakinnehållet**.
Postadress: Box 1284, 164 29 KISTA
Telefon: 08 - 444 14 00.
E-post: sek@elstandard.se. Internet: www.elstandard.se

Standarder underlättar utvecklingen och höjer elsäkerheten

Det finns många fördelar med att ha gemensamma tekniska regler för bl a mätning, säkerhet och provning och för utförande, skötsel och dokumentation av elprodukter och elanläggningar.

Genom att utforma sådana standarder blir säkerhetsfordringar tydliga och utvecklingskostnaderna rimliga samtidigt som marknadens acceptans för produkten eller tjänsten ökar.

Många standarder inom elområdet beskriver tekniska lösningar och metoder som åstadkommer den elsäkerhet som föreskrivs av svenska myndigheter och av EU.

SEK är Sveriges röst i standardiseringsarbetet inom elområdet

SEK Svensk Elstandard svarar för standardiseringen inom elområdet i Sverige och samordnar svensk medverkan i internationell och europeisk standardisering. SEK är en ideell organisation med frivilligt deltagande från svenska myndigheter, företag och organisationer som vill medverka till och påverka utformningen av tekniska regler inom elektrotekniken.

SEK samordnar svenska intressenters medverkan i SEKs tekniska kommittéer och stödjer svenska experters medverkan i internationella och europeiska projekt.

Stora delar av arbetet sker internationellt

Utformningen av standarder sker i allt väsentligt i internationellt och europeiskt samarbete. SEK är svensk nationalkommitté av International Electrotechnical Commission (IEC) och Comité Européen de Normalisation Electrotechnique (CENELEC).

Standardiseringsarbetet inom SEK är organiserat i referensgrupper bestående av ett antal tekniska kommittéer som speglar hur arbetet inom IEC och CENELEC är organiserat.

Arbetet i de tekniska kommittéerna är öppet för alla svenska organisationer, företag, institutioner, myndigheter och statliga verk. Den årliga avgiften för deltagandet och intäkter från försäljning finansierar SEKs standardiseringsverksamhet och medlemsavgift till IEC och CENELEC.

Var med och påverka!

Den som deltar i SEKs tekniska kommittéarbete har möjlighet att påverka framtida standarder och får tidig tillgång till information och dokumentation om utvecklingen inom sitt teknikområde. Arbetet och kontakterna med kollegor, kunder och konkurrenter kan gynnsamt påverka enskilda företags affärsutveckling och bidrar till deltagarnas egen kompetensutveckling.

Du som vill dra nytta av dessa möjligheter är välkommen att kontakta SEKs kansli för mer information.

SEK Svensk Elstandard

Box 1284
164 29 Kista
Tel 08-444 14 00
www.elstandard.se

English Version

**Information technology - Data centre facilities and infrastructures
- Part 5-1: Maturity Model for Energy Management and
Environmental Sustainability**

Technologies de l'information - Installation et infrastructures
des centres de traitement de données - Partie 5-1: Modèle
de maturité pour la gestion de l'énergie et la durabilité
environnementale

Informationstechnik - Einrichtungen und Infrastrukturen von
Rechenzentren - Teil 5-1: Reifegradmodell für
Energiemanagement und Umweltverträglichkeit

This Technical Specification was approved by CENELEC on 2023-08-28.

CENELEC members are required to announce the existence of this TS in the same way as for an EN and to make the TS available promptly at national level in an appropriate form. It is permissible to keep conflicting national standards in force.

CENELEC members are the national electrotechnical committees of Austria, Belgium, Bulgaria, Croatia, Cyprus, the Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, the Netherlands, Norway, Poland, Portugal, Republic of North Macedonia, Romania, Serbia, Slovakia, Slovenia, Spain, Sweden, Switzerland, Türkiye and the United Kingdom.



European Committee for Electrotechnical Standardization
Comité Européen de Normalisation Electrotechnique
Europäisches Komitee für Elektrotechnische Normung

CEN-CENELEC Management Centre: Rue de la Science 23, B-1040 Brussels

| Contents | Page |
|---|-------------|
| European foreword | 5 |
| Introduction..... | 6 |
| 1 Scope..... | 10 |
| 2 Normative references | 10 |
| 3 Terms, definitions and abbreviations | 11 |
| 3.1 Terms and definitions | 11 |
| 3.2 Abbreviations | 11 |
| 4 Concepts of data centre maturity | 12 |
| 4.1 Overview | 12 |
| 4.2 Basis of the maturity model | 13 |
| 4.2.1 Elements of the maturity model..... | 13 |
| 4.2.2 Reporting scheme..... | 13 |
| 4.3 Progress along the Levels of the maturity model | 14 |
| 4.4 Reporting of maturity model Levels..... | 14 |
| 4.5 Presentation of the maturity model | 15 |
| 5 Management and reporting | 16 |
| 5.1 Existing Data Centres (in operation) and new data centres | 16 |
| 5.1.1 Level 1 to level 3 | 16 |
| 5.1.2 Level 4 | 20 |
| 5.1.3 Level 5 | 21 |
| 5.2 New data centre infrastructure..... | 23 |
| 5.2.1 Level 1 to level 3 | 23 |
| 5.2.2 Level 4 | 23 |
| 5.2.3 Level 5 | 24 |
| 6 Building infrastructure..... | 25 |
| 6.1 Existing data centres (in operation) and new data centres | 25 |
| 6.1.1 Level 1 to level 3 | 25 |
| 6.1.2 Level 4 | 25 |
| 6.1.3 Level 5 | 25 |
| 6.2 New data centre infrastructure..... | 25 |
| 6.2.1 Level 1 to level 3 | 25 |
| 6.2.2 Level 4 | 26 |
| 6.2.3 Level 5 | 27 |
| 7 Power supply and distribution infrastructure | 27 |
| 7.1 Existing data centres (in operation) and new data centres | 27 |
| 7.1.1 Level 1 to level 3 | 27 |
| 7.1.2 Level 4 | 28 |
| 7.1.3 Level 5 | 29 |
| 7.2 New data centre infrastructure..... | 29 |
| 7.2.1 Level 1 to level 3 | 29 |
| 7.2.2 Level 4 | 30 |
| 7.2.3 Level 5 | 30 |
| 8 Environmental control infrastructure | 30 |
| 8.1 Existing data centres (in operation) and new data centres | 30 |

| | | |
|-----------------------|---|----|
| 8.1.1 | Level 1 to 3 | 30 |
| 8.1.2 | Level 4 | 34 |
| 8.1.3 | Level 5 | 36 |
| 8.2 | New data centre infrastructure..... | 36 |
| 8.2.1 | Level 1 to level 3 | 36 |
| 8.2.2 | Level 4 | 38 |
| 8.2.3 | Level 5 | 38 |
| 9 | ICT compute..... | 39 |
| 9.1 | Existing data centres (in operation) and new data centres | 39 |
| 9.1.1 | Level 1 to level 3 | 39 |
| 9.1.2 | Level 4 | 42 |
| 9.1.3 | Level 5 | 44 |
| 9.2 | New data centre infrastructure..... | 44 |
| 9.2.1 | Level 1 to level 3 | 44 |
| 9.2.2 | Level 4 | 44 |
| 9.2.3 | Level 5 | 44 |
| 10 | ICT Storage..... | 45 |
| 10.1 | Existing data centres (in operation) and new data centres | 45 |
| 10.1.1 | Level 1 to level 3 | 45 |
| 10.1.2 | Level 4 | 46 |
| 10.1.3 | Level 5 | 48 |
| 10.2 | New data centre infrastructure..... | 48 |
| 10.2.1 | Level 1 to level 3 | 48 |
| 10.2.2 | Level 4 | 48 |
| 10.2.3 | Level 5 | 49 |
| 11 | ICT network..... | 49 |
| 11.1 | Existing data centres (in operation) and new data centres | 49 |
| 11.1.1 | Level 1 to level 3 | 49 |
| 11.1.2 | Level 4 | 50 |
| 11.1.3 | Level 5 | 51 |
| 11.2 | New data centre infrastructure..... | 51 |
| 11.2.1 | Level 1 to level 3 | 51 |
| 11.2.2 | Level 4 | 51 |
| 11.2.3 | Level 5 | 51 |
| 12 | ICT Software | 51 |
| 12.1 | Existing data centres (in operation) and new data centres | 51 |
| 12.1.1 | Level 1 to level 3 | 51 |
| 12.1.2 | Level 4 | 52 |
| 12.1.3 | Level 5 | 52 |
| 12.2 | New data centre infrastructure..... | 53 |
| 12.2.1 | Level 1 to level 3 | 53 |
| 12.2.2 | Level 4 | 53 |
| 12.2.3 | Level 5 | 53 |
| Annex A (informative) | Additional practices for energy management | 54 |
| A.1 | Practices for energy management | 54 |
| A.2 | Environmental classifications..... | 56 |

| | |
|---|----|
| Annex B (informative) Additional practices for environmental sustainability | 58 |
| B.1 General | 58 |
| B.2 Practices for environmental sustainability | 60 |
| Annex C (informative) Cooling technologies | 63 |
| Bibliography | 64 |

Figures

| | |
|--|----|
| Figure 1 — Schematic relationship between the EN 50600 series of documents | 8 |
| Figure 2 — Example of the graphical representation of data centre maturity elements | 15 |
| Figure 3 — Example of the graphical representation of data centre maturity elements including some of Level 0 | 16 |
| Figure B.1 — Example system boundary for data centre LCA | 60 |

Tables

| | |
|--|----|
| Table A.1 — Equipment environmental specifications | 57 |
| Table A.2 — Equipment environmental specifications | 57 |
| Table C.1 — Examples of data centre cooling technologies | 63 |

European foreword

This document (CLC/TS 50600-5-1:2023) has been prepared by CLC/TC 215, "Electrotechnical aspects of telecommunication equipment".

This document supersedes CLC/TS 50600-5-1:2021, CLC/TR 50600-99-1:2021 and CLC/TR 50600-99-2:2021 and all of their amendments and corrigenda (if any).

CLC/TS 50600-5-1:2023 includes the following significant technical changes with respect to CLC/TS 50600-5-1:2021:

- a) document has been completely restructured with clauses organized in topics rather than maturity levels;
- b) previous references to CLC/TR 50600-99-1:2021 and CLC/TR 50600-99-2:2021 have been replaced by including the text into this document;
- c) the practices have been technically revised and consolidated to remove redundant requirements;
- d) practices of CLC/TR 50600-99-1:2021 and CLC/TR 50600-99-2:2021 not used in the maturity levels have been transferred to Annex A and Annex B, respectively, thus replacing the Technical Reports CLC/TR 50600-99-1:2021 and CLC/TR 50600-99-2:2021.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. CENELEC shall not be held responsible for identifying any or all such patent rights.

This document has been prepared under a standardization request addressed to CENELEC by the European Commission. The Standing Committee of the EFTA States subsequently approves these requests for its Member States.

Any feedback and questions on this document should be directed to the users' national committee. A complete listing of these bodies can be found on the CENELEC website.

Introduction

The unrestricted access to internet-based information demanded by the information society has led to an exponential growth of both internet traffic and the volume of stored/retrieved data. Data centres are housing and supporting the information technology and network telecommunications equipment for data processing, data storage and data transport. They are required both by network operators (delivering those services to customer premises) and by enterprises within those customer premises.

Data centres usually provide modular, scalable and flexible facilities and infrastructures to easily accommodate the rapidly changing requirements of the market. In addition, energy consumption of data centres has become critical both from an environmental point of view (reduction of environmental footprint) and with respect to economical considerations (cost of energy) for the data centre operator.

The implementation of data centres varies in terms of:

- a) purpose (enterprise, co-location, co-hosting or network operator facilities);
- b) security level;
- c) physical size;
- d) accommodation (mobile, temporary and permanent constructions).

The needs of data centres also vary in terms of availability of service, the provision of security and the objectives for energy efficiency. These needs and objectives influence the design of data centres in terms of building construction, power distribution, environmental control, telecommunications cabling and physical security as well as the operation of the data centre. Effective management and operational information is important in order to monitor achievement of the defined needs and objectives.

Recognizing the substantial resource consumption, particularly of energy, of larger data centres, it is also important to provide tools for the assessment of that consumption both in terms of overall value and of source mix and to provide Key Performance Indicators (KPIs) to evaluate trends and drive performance improvements.

At the time of publication of this document, the EN 50600 series is designed as a framework of standards, technical specifications and technical reports covering the design, the operation and management, the key performance indicators for energy efficient operation of the data centre as well as a data centre maturity model.

The EN 50600-2 series defines the requirements for the data centre design.

The EN 50600-3 series defines the requirements for the operation and the management of the data centre.

The EN 50600-4 series defines the key performance indicators for the data centre.

The CLC/TS 50600-5 series defines the data centre maturity model requirements and recommendations.

The CLC/TR 50600-99-X Technical Reports cover recommended practices and guidance for specific topics around data centre operation and design.

This series of documents specifies requirements and recommendations to support the various parties involved in the design, planning, procurement, integration, installation, operation, maintenance and assessment of facilities and infrastructures within data centres. These parties include:

- 1) owners, operators, facility managers, ICT managers, project managers, main contractors;
- 2) consulting engineers, architects, building designers and builders, system and installation designers, auditors, testing and commissioning agents;
- 3) facility and infrastructure integrators, suppliers of equipment;
- 4) installers, maintainers;
- 5) policy makers, assessors.

At the time of publication of this document, the EN 50600 series will comprise the following standards and documents:

- EN 50600-1, *Information technology — Data centre facilities and infrastructures — Part 1: General concepts*
- EN 50600-2-1, *Information technology — Data centre facilities and infrastructures — Part 2-1: Building construction*
- EN 50600-2-2, *Information technology — Data centre facilities and infrastructures — Part 2-2: Power supply and distribution*
- EN 50600-2-3, *Information technology — Data centre facilities and infrastructures — Part 2-3: Environmental control*
- EN 50600-2-4, *Information technology — Data centre facilities and infrastructures — Part 2-4: Telecommunications cabling infrastructure*
- EN 50600-2-5, *Information technology — Data centre facilities and infrastructures — Part 2-5: Security systems*
- EN 50600-3-1, *Information technology — Data centre facilities and infrastructures — Part 3-1: Management and operational information*
- EN 50600-4-1, *Information technology — Data centre facilities and infrastructures — Part 4-1: Overview of and general requirements for key performance indicators*
- EN 50600-4-2, *Information technology — Data centre facilities and infrastructures — Part 4-2: Power Usage Effectiveness*
- EN 50600-4-3, *Information technology — Data centre facilities and infrastructures — Part 4-3: Renewable Energy Factor*
- EN 50600-4-6, *Information technology — Data centre facilities and infrastructures — Part 4-6: Energy Reuse Factor*
- EN 50600-4-7, *Information technology — Data centre facilities and infrastructures — Part 4-7: Cooling Efficiency Ratio*
- EN 50600-4-8, *Information technology — Data centre facilities and infrastructures — Part 4-8: Carbon usage effectiveness*
- EN 50600-4-9, *Information technology — Data centre facilities and infrastructures — Part 4-9: Water usage effectiveness*
- CLC/TS 50600-5-1, *Information technology — Data centre facilities and infrastructures — Part 5-1: Maturity Model for Energy Management and Environmental Sustainability*
- CLC/TR 50600-99-3, *Information technology — Data centre facilities and infrastructures — Part 99-3: Guidance for the application of EN 50600 series*

The inter-relationship of the documents within the EN 50600 series is shown in Figure 1.

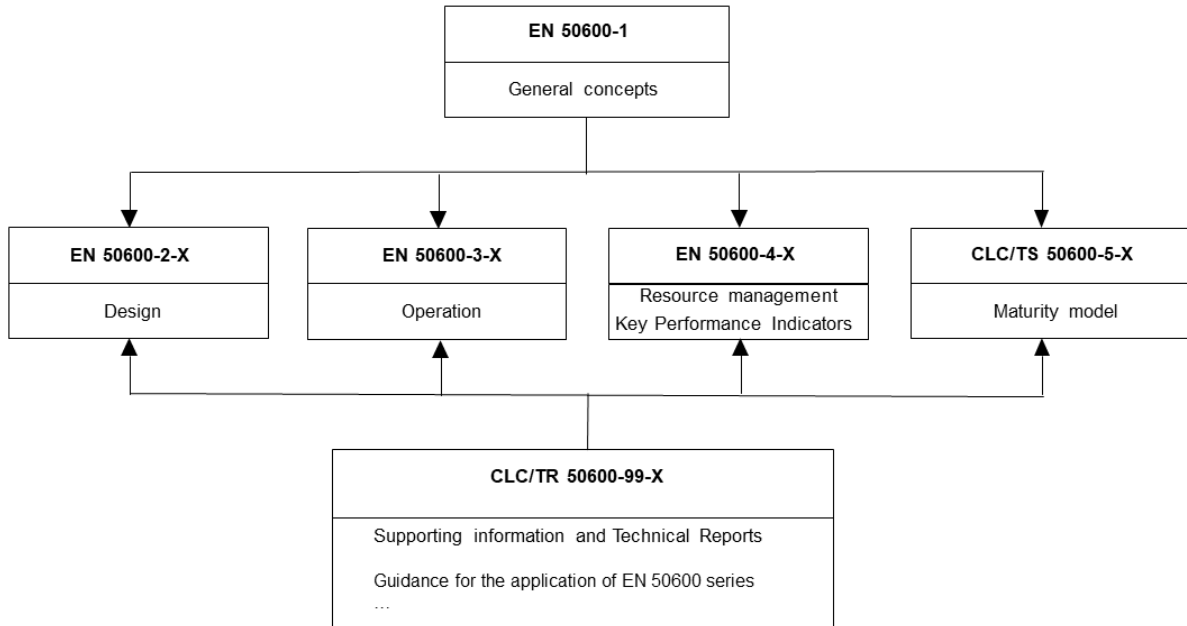


Figure 1 — Schematic relationship between the EN 50600 series of documents

EN 50600-2-X documents specify requirements and recommendations for particular facilities and infrastructures to support the relevant classification for “availability”, “physical security” and “energy efficiency enablement” selected from EN 50600-1.

EN 50600-3-X documents specify requirements and recommendations for data centre operations, processes and management.

EN 50600-4-X documents specify requirements and recommendations for key performance indicators (KPIs) used to assess and improve the resource usage efficiency and effectiveness, respectively, of a data centre.

This document, CLC/TS 50600-5-1 describes a 5-level maturity model which separately addresses multiple elements of the facilities, infrastructures, the information and communication technology (ICT) equipment and software of the data centre; while the current document focusses on the environmental impact (energy management and environmental sustainability), other elements are expected to be included in future documents.

NOTE The term “environmental sustainability” is used recognizing that well established treatments of “sustainability” feature three separate viability objectives (environmental, economic and social). For the purposes of this document, only elements of environmental viability are considered.

The maturity model covers design, procurement, operation and end-of-life.

The purpose of the document is to enable data centre owners/operators to:

- employ a framework to baseline their data centre design and practices;
- determine the level of maturity applicable to their data centre by assessment;
- identify relevant guidance on potential areas of improvement together with the anticipated benefits to justify the resources required;
- develop an action plan to migrate to higher maturity levels.

This document supports the wider adoption of recommended practices of other documents in the EN 50600 series and those of other recognized relevant standards in the area of energy management and environmental

sustainability. The document can be useful in an assessment process to define the level of environmental impact maturity of a data centre.

1 Scope

This document specifies a maturity model addressing the environmental impact (energy management and environmental sustainability) of the facilities, infrastructures and the information and communication technology (ICT) equipment accommodated by and the and ICT software deployed in the data centre.

NOTE The term "environmental sustainability" is used recognizing that well established treatments of "sustainability" feature three separate viability objectives (environmental, economic and social). For the purposes of this document, only elements of environmental viability are considered.

The elements address the whole life cycle including design, procurement, operation and decommissioning.

2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

EN 14511 (all parts), *Air conditioners, liquid chilling packages and heat pumps with electrically driven compressors for space heating and cooling*

EN 50600 (all parts), *Information technology – Data centre facilities and infrastructures*

EN 50600-1, *Information technology - Data centre facilities and infrastructures - Part 1: General concepts*

EN 50600-4-2, *Information technology - Data centre facilities and infrastructures - Part 4-2: Power Usage Effectiveness*

EN 50600-4-3, *Information technology - Data centre facilities and infrastructures - Part 4-3: Renewable Energy Factor*

EN 50600-4-6, *Information technology - Data centre facilities and infrastructures - Part 4-6: Energy Reuse Factor*

EN 50600-4-7, *Information technology - Data centre facilities and infrastructures - Part 4-7: Cooling Efficiency Ratio*

EN 50600-4-9, *Information technology - Data centre facilities and infrastructures - Part 4-9: Water Usage Effectiveness*

ISO/IEC 20000 (all parts), *Information technology — Service management*

ISO/IEC 30134-4, *Information technology — Data centres — Key performance indicators — Part 4: IT Equipment Energy Efficiency for servers (ITEEsv)*

ISO/IEC 30134-5, *Information technology — Data centres — Key performance indicators — Part 5: IT Equipment Utilization for servers (ITEUsv)*

EN ISO 14040, *Environmental management - Life cycle assessment - Principles and framework (ISO 14040)*

EN ISO 16890-1, *Air filters for general ventilation - Part 1: Technical specifications, requirements and classification system based upon particulate matter efficiency (ePM) (ISO 16890-1)*

ITU-T L.1410, *Methodology for environmental life cycle assessments of information and communication technology goods, networks and services*