

© Copyright SEK Svensk Elstandard. Reproduction in any form without permission is prohibited.

## Datahallsutrymmen och tillhörande system – Del 2-4: Infrastruktur för telekommunikationsnät

*Information technology - Data centre facilities and infrastructures –  
Part 2-4: Telecommunications cabling infrastructure*

Som svensk standard gäller europastandarden EN 50600-2-4:2023. Den svenska standarden innehåller den officiella engelska språkversionen av EN 50600-2-4:2023.

### Nationellt förord

Tidigare fastställd svensk standard SS-EN 50600-2-4:2015 med eventuella tillägg, ändringar och rättelser gäller ej fr o m 2026-03-20.

---

ICS 35.020.00; 35.110.00; 35.160.00

---

Denna standard är fastställd av SEK Svensk Elstandard, som också kan lämna upplysningar om **sakinnehållet** i standarden.  
Postadress: Box 1284, 164 29 KISTA  
Telefon: 08 - 444 14 00.  
E-post: [sek@elstandard.se](mailto:sek@elstandard.se). Internet: [www.elstandard.se](http://www.elstandard.se)

---

### *Standarder underlättar utvecklingen och höjer elsäkerheten*

Det finns många fördelar med att ha gemensamma tekniska regler för bl a mätning, säkerhet och provning och för utförande, skötsel och dokumentation av elprodukter och elanläggningar.

Genom att utforma sådana standarder blir säkerhetsfordringar tydliga och utvecklingskostnaderna rimliga samtidigt som marknadens acceptans för produkten eller tjänsten ökar.

Många standarder inom elområdet beskriver tekniska lösningar och metoder som åstadkommer den elsäkerhet som föreskrivs av svenska myndigheter och av EU.

### *SEK är Sveriges röst i standardiseringsarbetet inom elområdet*

SEK Svensk Elstandard svarar för standardiseringen inom elområdet i Sverige och samordnar svensk medverkan i internationell och europeisk standardisering. SEK är en ideell organisation med frivilligt deltagande från svenska myndigheter, företag och organisationer som vill medverka till och påverka utformningen av tekniska regler inom elektrotekniken.

SEK samordnar svenska intressenters medverkan i SEKs tekniska kommittéer och stödjer svenska experters medverkan i internationella och europeiska projekt.

### *Stora delar av arbetet sker internationellt*

Utformningen av standarder sker i allt väsentligt i internationellt och europeiskt samarbete. SEK är svensk nationalkommitté av International Electrotechnical Commission (IEC) och Comité Européen de Normalisation Electrotechnique (CENELEC).

Standardiseringsarbetet inom SEK är organiserat i referensgrupper bestående av ett antal tekniska kommittéer som speglar hur arbetet inom IEC och CENELEC är organiserat.

Arbetet i de tekniska kommittéerna är öppet för alla svenska organisationer, företag, institutioner, myndigheter och statliga verk. Den årliga avgiften för deltagandet och intäkter från försäljning finansierar SEKs standardiseringsverksamhet och medlemsavgift till IEC och CENELEC.

### *Var med och påverka!*

Den som deltar i SEKs tekniska kommittéarbete har möjlighet att påverka framtida standarder och får tidig tillgång till information och dokumentation om utvecklingen inom sitt teknikområde. Arbetet och kontakterna med kollegor, kunder och konkurrenter kan gynnsamt påverka enskilda företags affärsutveckling och bidrar till deltagarnas egen kompetensutveckling.

Du som vill dra nytta av dessa möjligheter är välkommen att kontakta SEKs kansli för mer information.

### **SEK Svensk Elstandard**

Box 1284  
164 29 Kista  
Tel 08-444 14 00  
[www.elstandard.se](http://www.elstandard.se)

English Version

## Information technology - Data centre facilities and infrastructures - Part 2-4: Telecommunications cabling infrastructure

Technologies de l'information - Installation et infrastructures  
de centres de traitement de données - Partie 2-4:  
Infrastructure du câblage dédié aux télécommunications

Informationstechnik - Einrichtungen und Infrastrukturen von  
Rechenzentren - Teil 2-4: Infrastruktur der  
Telekommunikationsverkabelung

This European Standard was approved by CENELEC on 2023-03-20. CENELEC members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration.

Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the CEN-CENELEC Management Centre or to any CENELEC member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CENELEC member into its own language and notified to the CEN-CENELEC Management Centre has the same status as the official versions.

CENELEC members are the national electrotechnical committees of Austria, Belgium, Bulgaria, Croatia, Cyprus, the Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, the Netherlands, Norway, Poland, Portugal, Republic of North Macedonia, Romania, Serbia, Slovakia, Slovenia, Spain, Sweden, Switzerland, Türkiye and the United Kingdom.



European Committee for Electrotechnical Standardization  
Comité Européen de Normalisation Electrotechnique  
Europäisches Komitee für Elektrotechnische Normung

**CEN-CENELEC Management Centre: Rue de la Science 23, B-1040 Brussels**

<b>Contents</b>		Page
<b>European foreword</b> .....		<b>5</b>
<b>Introduction</b> .....		<b>6</b>
<b>1</b>	<b>Scope</b> .....	<b>9</b>
<b>2</b>	<b>Normative references</b> .....	<b>9</b>
<b>3</b>	<b>Terms, definitions and abbreviations</b> .....	<b>10</b>
3.1	Terms and definitions .....	10
3.2	Abbreviations .....	14
<b>4</b>	<b>Conformance</b> .....	<b>15</b>
<b>5</b>	<b>Telecommunications cabling within the data centre</b> .....	<b>15</b>
5.1	General .....	15
5.2	Requirements for cabling supporting the IT operations in all data centre spaces.....	16
5.3	Requirements for cabling providing distributed building services in all data centre spaces .....	16
5.4	Requirements for cabling for IT and network telecommunications to and within the computer room space.....	17
5.4.1	General .....	17
5.4.2	Point-to-point cabling .....	17
5.4.3	Requirements for fixed cabling .....	19
<b>6</b>	<b>Implementation of cabling in accordance with EN 50173-5</b> .....	<b>20</b>
6.1	General .....	20
6.2	Functional elements.....	20
6.3	Distribution areas and spaces .....	21
6.3.1	General .....	21
6.3.2	Distribution areas.....	23
6.3.3	Building entrance facility .....	24
6.3.4	Entrance rooms .....	25
6.4	Infrastructures supporting the functional elements of EN 50173-5 .....	25
6.4.1	General .....	25
6.4.2	Pathways and pathway systems for telecommunications cabling.....	25
6.4.3	Cabinets, frames and racks for the computer room space.....	26
<b>7</b>	<b>Physical Security</b> .....	<b>27</b>
7.1	General .....	27
7.2	Protection against unauthorized access .....	27
7.2.1	Pathways and spaces.....	27
7.2.2	Entrance room .....	28
7.3	Protection against internal events .....	28

<b>8</b>	<b>Availability classification for the telecommunications cabling infrastructure, infrastructure elements, facilities and spaces</b> .....	<b>28</b>
8.1	General .....	28
8.2	Availability design principles for telecommunications cabling infrastructure .....	29
8.3	Overview about the availability classes for telecommunications cabling .....	30
8.4	Availability Class design requirements and recommendations .....	30
8.4.1	Transmission channel design for the network distribution cabling .....	30
8.4.2	Availability Class 1 .....	31
8.4.3	Availability Class 2 .....	32
8.4.4	Availability Class 3 .....	35
8.4.5	Availability Class 4 .....	38
<b>9</b>	<b>Management and operation of the telecommunications cabling infrastructure</b> .....	<b>40</b>
9.1	General .....	40
9.2	Automated infrastructure management systems .....	40
	<b>Annex A (informative) Design concepts for network distribution cabling</b> .....	<b>41</b>
	<b>Annex B (informative) Energy efficiency considerations for the telecommunications cabling infrastructure</b> .....	<b>50</b>
	<b>Annex C (informative) Summary of requirements</b> .....	<b>51</b>
	<b>Annex D (informative) Examples of telecommunications cabling infrastructures including active equipment</b> .....	<b>53</b>
	<b>Annex E (informative) Availability description</b> .....	<b>56</b>
	<b>Annex F (normative) Availability Classes for cabling infrastructures in colocation data centres</b> ..	<b>57</b>
	<b>Bibliography</b> .....	<b>61</b>
<b>Figures</b>		
	Figure 1 — Schematic relationship between the EN 50600 series of documents .....	7
	Figure 2 — Schematic relationship between the EN 50600-2-4 and other European cabling design and installation standards .....	8
	Figure 3 — Impact of growth in an unstructured point-to-point cabling infrastructure .....	18
	Figure 4 — Structured cabling infrastructure: setup and growth .....	19
	Figure 5 — Functional elements and cabling subsystems of EN 50173-5 .....	21
	Figure 6 — Facilities and spaces relevant for cabling according EN 50173-5 .....	22
	Figure 7 — Areas providing accommodation for distributors of EN 50173-5 and connected active equipment .....	23
	Figure 8 — Principle of supply and distribution .....	29
	Figure 9 — Transmission channels (interconnect and cross-connect) .....	31
	Figure 10 — Telecommunication cabling Class 1 using direct attached cords .....	32
	Figure 11 — Telecommunication cabling Class 1 .....	32
	Figure 12 — Telecommunication cabling Class 2 .....	33
	Figure 13 — Managing moves, adds and changes .....	34
	Figure 14 — Telecommunication cabling Class 3 with one entrance room .....	36

Figure 15 — Telecommunication cabling Class 3 with two entrance rooms.....36

Figure 16 — Telecommunication cabling Class 4.....39

Figure A.1 — Symbols of network elements .....41

Figure A.2 — Example of a Class 1 cabling implementation .....42

Figure A.3 — Example for Class 2 EoR cabling implementation .....43

Figure A.4 — Example for Class 2 MoR cabling implementation .....44

Figure A.5 — Example for Class 2 ToR cabling implementation .....45

Figure A.6 — Example for Class 3 EoR cabling implementation .....46

Figure A.7 — Example for Class 3 ToR cabling implementation .....47

Figure A.8 — Example for Class 4 EoR cabling implementation .....48

Figure A.9 — Example for Class 4 ToR cabling implementation .....49

Figure D.1 — Example of Availability Class 3 cabling and active equipment with one entrance room .....53

Figure D.2 — Example of Availability Class 3 cabling and active equipment with two entrance rooms.....54

Figure D.3 — Example of Availability Class 4 cabling and active equipment.....54

Figure D.4 — Example of Availability Class 3 cabling and active equipment implemented across multiple floors.....55

Figure D.5 — Example of Availability Class 3 cabling and active equipment implemented across multiple floors.....55

Figure F.1 — Telecommunications supply cabling for a single building colocation (AC 3) .....59

Figure F.2 — Telecommunications supply cabling for a single building colocation (AC 4) .....59

Figure F.3 — Telecommunications supply cabling for a multi building colocation (AC 4) .....60

**Tables**

Table 1 — Telecommunication cabling Availability Classes per space and overall data centre Availability Class.....30

Table C.1 — Telecommunications cabling infrastructure requirements per Availability Class .....51

Table E.1 — Summary of availability classification.....56

## European foreword

This document (EN 50600-2-4:2023) has been prepared by CLC/TC 215 “Electrotechnical aspects of telecommunication equipment”.

The following dates are fixed:

- latest date by which this document has to be implemented at national level by publication of an identical national standard or by endorsement (dop) 2024-03-20
- latest date by which the national standards conflicting with this document have to be withdrawn (dow) 2026-03-20

This document supersedes EN 50600-2-4:2015.

The following major modifications have been made compared to EN 50600-2-4:2015:

- a) the document structure has been completely revised;
- b) the availability classes have been revised;
- c) a clause on physical security has been added (Clause 7);
- d) Annex C summarizing the requirements and recommendations of the document has been added;
- e) Annex D with examples for cabling infrastructures including the location of active equipment has been added;
- f) Annex E with an availability description has been added;
- g) Annex F with specific requirements for colocation data centres has been added.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. CENELEC shall not be held responsible for identifying any or all such patent rights.

This document has been prepared under a Standardization Request given to CENELEC by the European Commission and the European Free Trade Association.

Any feedback and questions on this document should be directed to the users' national committee. A complete listing of these bodies can be found on the CENELEC website.

## Introduction

The unrestricted access to internet-based information demanded by the information society has led to an exponential growth of both internet traffic and the volume of stored/retrieved data. Data centres are housing and supporting the information technology and network telecommunications equipment for data processing, data storage and data transport. They are required both by network operators (delivering those services to customer premises) and by enterprises within those customer premises.

Data centres usually provide modular, scalable and flexible facilities and infrastructures to easily accommodate the rapidly changing requirements of the market. In addition, energy consumption of data centres has become critical both from an environmental point of view (reduction of carbon footprint) and with respect to economical considerations (cost of energy) for the data centre operator.

The implementation of data centres varies in terms of:

- a) purpose (enterprise, co-location, co-hosting or network operator facilities);
- b) security level;
- c) physical size;
- d) accommodation (mobile, temporary and permanent constructions).

The needs of data centres also vary in terms of availability of service, the provision of security and the objectives for energy efficiency. These needs and objectives influence the design of data centres in terms of building construction, power distribution, environmental control telecommunications cabling and physical security as well as the operation of the data centre. Effective management and operational information is required to monitor achievement of the defined needs and objectives.

Recognizing the substantial resource consumption, particularly of energy, of larger data centres, it is also important to provide tools for the assessment of that consumption both in terms of overall value and of source mix and to provide Key Performance Indicators (KPIs) to evaluate trends and drive performance improvements.

At the time of publication of this document, the EN 50600 series is designed as a framework of standards, technical specifications and technical reports covering the design, the operation and management, the key performance indicators for energy efficient operation of the data centre as well as a data centre maturity model.

The EN 50600-2 series defines the requirements for the data centre design.

The EN 50600-3 series defines the requirements for the operation and the management of the data centre.

The EN 50600-4 series defines the key performance indicators for the data centre.

The CLC/TS 50600-5 series defines the data centre maturity model requirements and recommendations.

The CLC/TR 50600-99-X Technical Reports cover recommended practices and guidance for specific topics around data centre operation and design.


This series of documents specifies requirements and recommendations to support the various parties involved in the design, planning, procurement, integration, installation, operation and maintenance of facilities and infrastructures within data centres. These parties include:

- 1) owners, operators, facility managers, ICT managers, project managers, main contractors;
- 2) consulting engineers, architects, building designers and builders, system and installation designers, auditors, test and commissioning agents;
- 3) facility and infrastructure integrators, suppliers of equipment;
- 4) installers, maintainers.

At the time of publication of this document, the EN 50600-2 series comprises the following documents:

- EN 50600-2-1, *Information technology - Data centre facilities and infrastructures - Part 2-1: Building construction*
- CLC/TS 50600-2-10, *Information technology - Data centre facilities and infrastructures - Part 2-10: Earthquake risk and impact analysis*
- EN 50600-2-2, *Information technology - Data centre facilities and infrastructures - Part 2-2: Power supply and distribution*
- EN 50600-2-3, *Information technology - Data centre facilities and infrastructures - Part 2-3: Environmental control*
- EN 50600-2-4, *Information technology - Data centre facilities and infrastructures - Part 2-4: Telecommunications cabling infrastructure*
- EN 50600-2-5, *Information technology - Data centre facilities and infrastructures - Part 2-5: Security systems*

The inter-relationship of the documents within the EN 50600 series is shown in Figure 1.

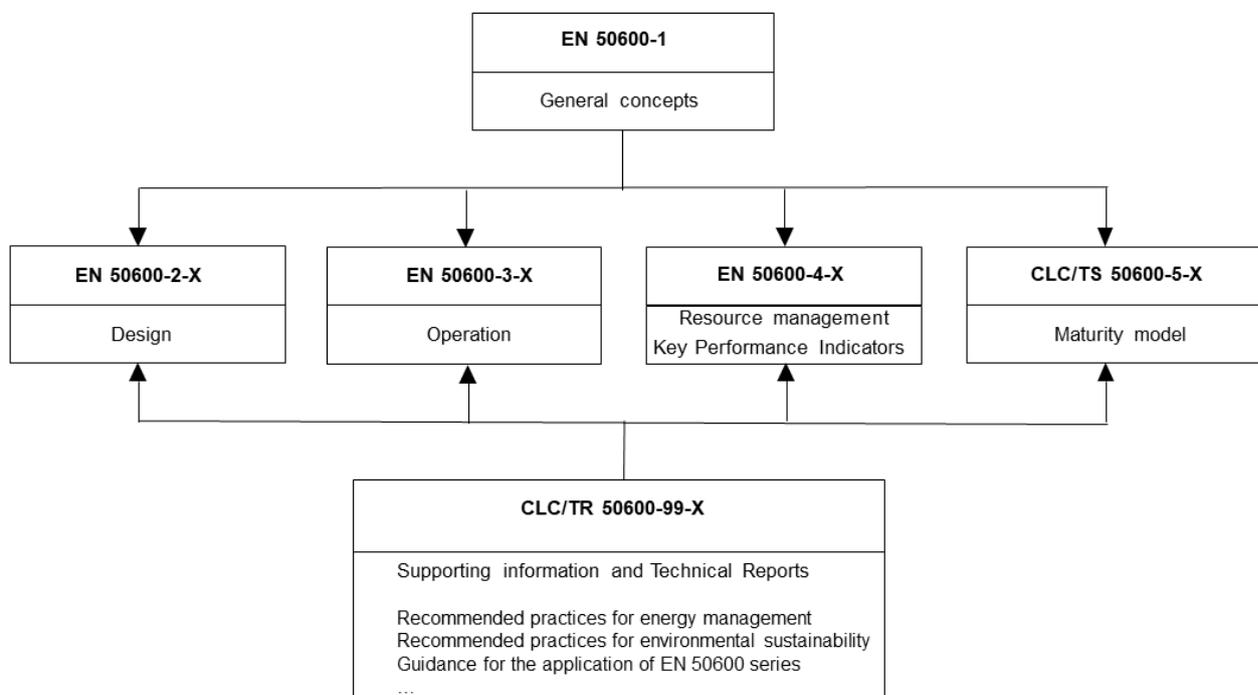

**Figure 1 — Schematic relationship between the EN 50600 series of documents**

EN 50600-2-X documents specify requirements and recommendations for particular facilities and infrastructures to support the relevant classification for “availability”, “physical security” and “energy efficiency enablement” selected from EN 50600-1.

EN 50600-3-X documents specify requirements and recommendations for data centre operations, processes and management.


EN 50600-4-X documents specify requirements and recommendations for key performance indicators (KPIs) used to assess and improve the resource usage efficiency and effectiveness, respectively, of a data centre.

This document addresses the specific requirements for the telecommunications cabling infrastructure in data centres used for the purpose of IT networking and building services (in accordance with the requirements of EN 50600-1).

This document is intended for use by and collaboration between architects, building designers and builders, system and installation designers.

This series of documents does not address the selection of information technology and network telecommunications equipment, software and associated configuration issues.

Figure 2 shows the schematic and contextual relationships of the EN 50600-2-4 with other cabling and cabling installation related European standards.

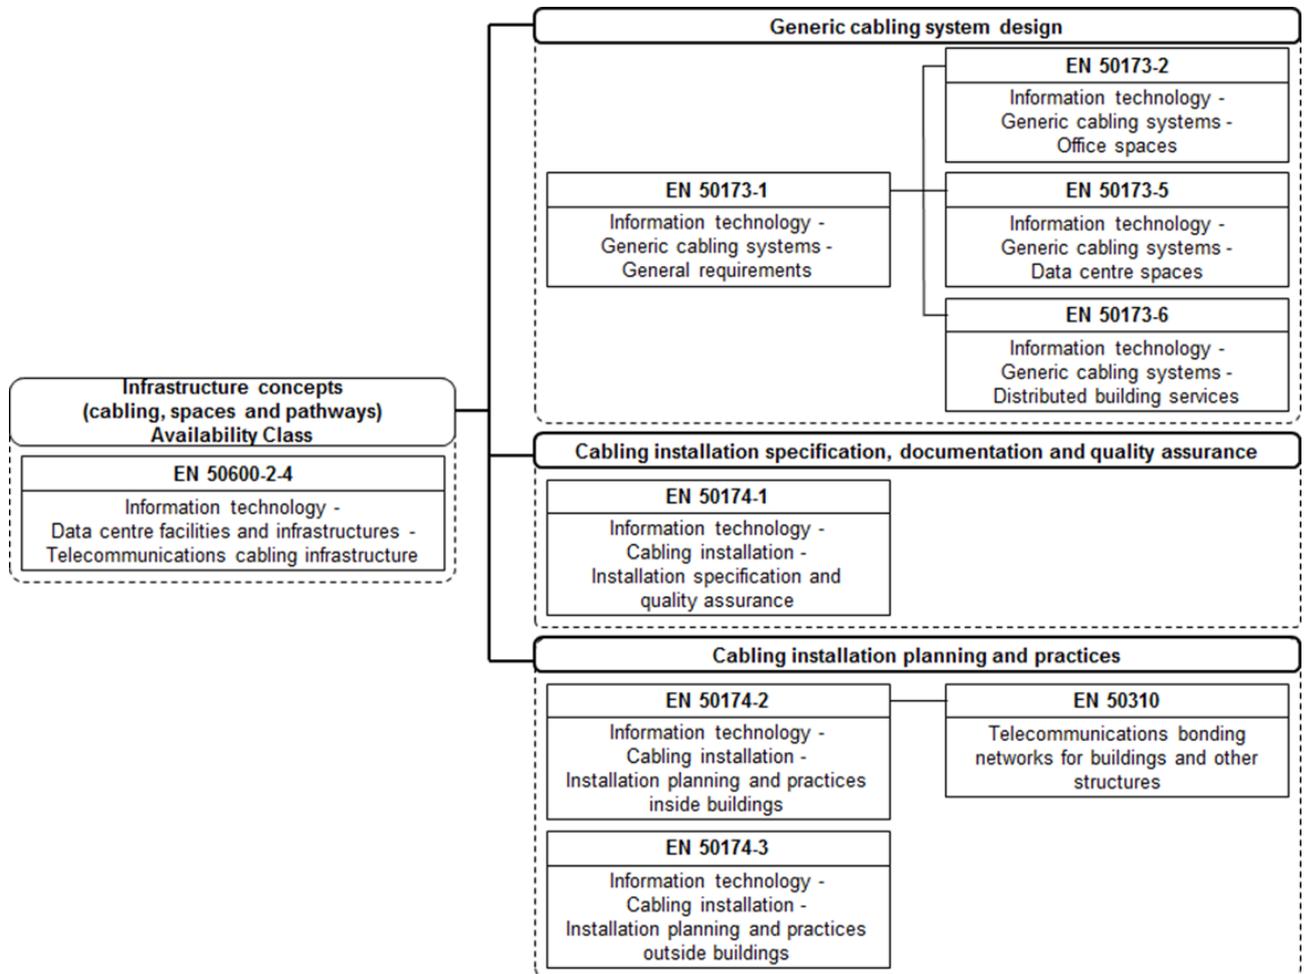

**Figure 2 — Schematic relationship between the EN 50600-2-4 and other European cabling design and installation standards**

The importance of the information technology and network telecommunications cabling infrastructure is similar to that of other infrastructures such as environmental control, power distribution and security systems. As with other utilities, interruptions to service can have a serious impact. Poor quality of service due to lack of planning, use of inappropriate components, incorrect installation, poor administration or inadequate support can threaten an organization's effectiveness.

## 1 Scope

This document specifies design principles for information technology and network telecommunications cabling (e.g. SAN and LAN) in accordance with EN 50173-5, based upon the criteria and classifications for “availability” and “physical security” within EN 50600-1.

This document addresses the telecommunications cabling infrastructures used in data centres. It describes:

- a) for design, the application of generic cabling standards in the EN 50173 series;
- b) for installation specification, planning and practices and quality assurance, the application of standards in the EN 50174 series (and related standards).

In addition, this document specifies requirements and recommendations for the following:

- 1) general information technology cabling to support the IT operation of the data centre;
- 2) telecommunications cabling to monitor and control, as appropriate, power distribution, environmental control and physical security of the data centre;
- 3) other building automation cabling;
- 4) pathways, pathway systems, spaces and enclosures for the telecommunications cabling infrastructures.

Safety and electromagnetic compatibility (EMC) requirements are outside the scope of this document and are covered by other standards and regulations. However, information given in this document can be of assistance in meeting these standards and regulations.

## 2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

EN 50173-2, *Information technology - Generic cabling systems - Part 2: Office spaces*

EN 50173-5, *Information technology - Generic cabling systems - Part 5: Data centre spaces*

EN 50173-6, *Information technology - Generic cabling systems - Part 6: Distributed building services*

EN 50174-1:2018,<sup>1</sup> *Information technology — Cabling installation — Part 1: Installation specification and quality assurance*

EN 50174-2:2018, *Information technology - Cabling installation - Part 2: Installation planning and practices inside buildings*

EN 50174-3, *Information technology - Cabling installation - Part 3: Installation planning and practices outside buildings*

EN 50310, *Telecommunications bonding networks for buildings and other structures*

EN 50600-1:2019, *Information technology - Data centre facilities and infrastructures - Part 1: General concepts*

EN 50600-2-1, *Information technology — Data centre facilities and infrastructures — Part 2-1: Building construction*

---

<sup>1</sup> As amended by EN 50174-1:2018/A1:2020.

**EN 50600-2-4:2023 (E)**

EN 50600-2-2, *Information technology - Data centre facilities and infrastructures - Part 2-2: Power supply and distribution*

EN 50600-2-3, *Information technology - Data centre facilities and infrastructures - Part 2-3: Environmental control*

EN 50600-2-5, *Information technology — Data centre facilities and infrastructures — Part 2-5: Security systems*